

---

ABB MEASUREMENT & ANALYTICS | DATA SHEET

# TTF300-W WirelessHART

## Field-mount temperature transmitter



---

## **Measurement made easy**

Wireless temperature measurement

---

**WirelessHART (IEC 62591)**

---

**Power supply via standard lithium battery with long service life**

---

**Fast and easy commissioning**

---

**Intuitive and intelligent operating concept**

---

**Configuration directly on the LCD indicator without external Power supply**

---

**Approvals for explosion protection**

- ATEX
- IECEx
- cFMus

## Specification

### Electromagnetic compatibility

Interference immunity in accordance with IEC/EN 61326-1 (industrial environment, influence < 1%)

### Vibration resistance in accordance with IEC 60068-2-6

10 to 60 Hz 0.21 mm / 60 to 2000 Hz 3g

### Humidity in accordance with IEC60068-2-30

95%

### With integrated adjustable omnidirectional antenna

Range: up to 300 m (328 yds)

### Wireless refresh rate

- Standard 16 seconds
- Can be configured between 4 seconds and 60 minutes

### Transmission protocol

WirelessHART® Version 7 (IEEE 802.15.4-2006)

### Frequency band

2.4 GHz (ISM-band, license-free)

### Transmission power

max. 10 mW (10 dBm) EIRP

### Minimum distance between antenna and persons

0.2 m (8 in)

User-defined configuration of Network ID & Join Key through LCD indicator with button operation or through EDD or DTM.

### Ambient temperature

- -40 to 85 °C (-40 to 185 °F)
- optional -50 to 85 °C (-58 to 185 °F)  
(restricted range during operation with LCD indicator or with explosion-proof design)

### Electrical connections

- Spring cage terminals
- Connection leads up to max. 1.5 mm<sup>2</sup> (AWG 16)

### Material

- Aluminum, epoxy-coated
- Stainless steel

### Color

gray RAL 9002

### IP rating

IP 66 / IP 67

## LCD indicator

In the connection head

For displaying measurement and status information

For on-site configuration

Automatic shutdown after 1 minute without activating the buttons (can be configured)

Manual reactivation via push buttons



Figure 1: LCD indicator

## Power supply

### Battery

Standard lithium battery (lithium content 5 g)

Service life of 5 years under the following reference conditions

- 25 °C (77 °F) ambient temperature
- Refresh rate 8 s
- Data forwarding of 3 additional network participants
- LCD off

## ... Specification

### Input - resistance thermometer / resistances

#### Resistance thermometer

- Pt100 in accordance with IEC 60751, JIS C1604, MIL-T-24388
- Ni in accordance with DIN 43760
- Cu in accordance with recommendation OIML R 84

#### Resistance measurement

- 0 to 500  $\Omega$
- 0 to 5000  $\Omega$

#### Sensor connection type

Two-, three-, four-wire circuit

#### Connection lead

- Maximum sensor line resistance per line 50  $\Omega$  in accordance with NE 89
- Three-wire circuit: Symmetrical sensor line resistances
- Two-wire circuit: Compensation up to 100  $\Omega$  total lead resistance

#### Measurement current

< 300  $\mu$ A

#### Sensor short circuit

< 5  $\Omega$  (for resistance thermometer)

#### Sensor wire break

- Measuring range: 0 to 500  $\Omega$  > 0.6 to 10 k $\Omega$
- Measuring range: 0 to 5  $\Omega$  > 5.3 to 10 k $\Omega$

#### Corrosion detection in accordance with NE 89

- Three-wire resistance measurement > 50  $\Omega$
- Four-wire resistance measurement > 50  $\Omega$

#### Sensor error signaling

- Resistance thermometer: Sensor short circuit and sensor wire break
- Linear resistance measurement: Sensor wire break

### Input - thermocouples / voltages

#### Types

- B, E, J, K, N, R, S, T in accordance with IEC 60584
- U, L in accordance with DIN 43710
- C, D in accordance with ASTM E-988

#### Voltages

- -125 to 125 mV
- -125 to 1100 mV

#### Connection lead

- Maximum sensor line resistance 1.5 k $\Omega$  per wire, 3 k $\Omega$  in total

#### Sensor wire break monitoring in accordance with NE 89

- Pulsed with 1  $\mu$ A outside measurement interval
- Thermocouple measurement 5.3 to 10 k $\Omega$
- Voltage measurement 5.3 to 10 k $\Omega$

#### Input resistance

> 10 M $\Omega$

#### Internal reference junction

Pt1000, IEC 60751 Cl. B

#### Sensor error signaling

- Thermocouple: wire break
- Linear voltage measurement: wire break

## Functionality input

### Freestyle characteristic / 32-points-sampling point table

- Resistance measurement up to a maximum of 5 k $\Omega$
- Voltages up to maximum 1.1 V

#### Sensor error adjustment

- Through Callendar-Van Dusen coefficients
- Through value table, 32 support points
- Through single-point adjustment (offset adjustment)
- Through two-point adjustment

#### Input functionality

- 1 Sensor
- 2 Sensors: mean measurement, differential measurement, sensor redundancy, Sensor drift monitoring

## Measuring accuracy

Includes linearity error, repeatability / hysteresis at 23 °C (73.4 °F) ±5 K ambient temperature.  
Information on measuring accuracy corresponds to 3  $\sigma$  (Gaussian distribution).

Sensor	Measuring range limit	Minimum span	Digital measuring accuracy (24-bit AD-converter)	
<b>Resistance thermometer / resistor</b>				
DIN IEC 60751	Pt10 (a=0.003850)	-200 to 850 °C (-328 to 1562 °F)	10 °C (18 °F)	±0.80 °C (±1.44 °F)
	Pt50 (a=0.003850)		±0.16 °C (±0.29 °F)	
	Pt100 (a=0.003850)**		±0.08 °C (±0.14 °F)	
	Pt200 (a=0.003850)		±0.24 °C (±0.43 °F)	
	Pt500 (a=0.003850)		±0.16 °C (±0.29 °F)	
	Pt1000 (a=0.003850)		±0.08 °C (±0.14 °F)	
JIS C1604-89	-200 to 645 °C	10 °C (18 °F)	±0.80 °C (±1.44 °F)	
			±0.16 °C (±0.29 °F)	
			±0.08 °C (±0.14 °F)	
MIL-T-24388	-200 to 850 °C	10 °C (18 °F)	±0.80 °C (±1.44 °F)	
			±0.16 °C (±0.29 °F)	
			±0.08 °C (±0.14 °F)	
			±0.24 °C (±0.43 °F)	
			±0.08 °C (±0.14 °F)	
DIN 43760	-60 to 250 °C	10 °C (18 °F)	±0.16 °C (±0.29 °F)	
			±0.08 °C (±0.14 °F)	
OIML R 84	-50 to 200 °C	10 °C (18 °F)	±0.80 °C (±1.44 °F)	
			±0.08 °C (±0.14 °F)	
			Resistance measurement	0 to 500 $\Omega$
	0 to 5000 $\Omega$	40 $\Omega$	±320 m $\Omega$	
<b>Thermocouples*** / voltages</b>				
IEC 60584	Type K (Ni10Cr-Ni5)	-270 to 1372 °C (-454 to 2502 °F)	50 °C (90 °F)	±0.35 °C (±0.63 °F)
	Type J (Fe-Cu45Ni)			
	Type N (Ni14CrSi-NiSi)			
	Type T (Cu-Cu45Ni)			
	Type E (Ni10Cr-Cu45Ni)	-270 to 1000 °C (-454 to 1832 °F)	100 °C (180 °F)	±0.95 °C (±1.71 °F)
	Type R (Pt13Rh-Pt)			
	Type S (Pt10Rh-Pt)			
Type B (Pt30Rh-Pt6Rh)	0 to 1820 °C (32 to 3308 °F)			
DIN 43710	Type L (Fe-CuNi)	-200 to 900 °C (-328 to 1652 °F)	50 °C (90 °F)	±0.35 °C (±0.63 °F)
	Type U (Cu-CuNi)	-200 to 600 °C (-328 to 1112 °F)		
ASTM E 988	Type C	0 to 2315 °C (32 to 4200 °F)	100 °C (180 °F)	±1.35 °C (±2.43 °F)
	Type D			
	Voltage measurement	-125 to 125 mV	2 mV	±12 $\mu$ V
		-125 to 1100 mV	20 mV	±120 $\mu$ V

Long-term drift: ±0.05 °C (±0.09 °F) or ±0.05 %\* per year, the larger value applies.

\* Percentages refer to the configured measuring span

\*\* Standard Version

\*\*\* For digital measuring accuracy, the internal reference junction error must be added: Pt1000, DIN IEC 60751 Cl. B

## ... Specification

### Operating influence

The percentages refer to the configured measuring span.

Ambient temperature effect: based on 23 °C (73.4 °F) for ambient temperature range -40 to 85 °C (-40 to 185 °F)\*\*

Sensor	Ambient temperature effect per 1 °C (1.8 °F) deviation from 23 °C (73.4 °F) (digital measurement value)	
Resistance thermometer for two-, three- and four-wire circuits		
IEC, JIS, MIL	Pt10	±0,04 °C (±0.072 °F)
	Pt50	±0.008 °C (±0.014 °F)
	Pt100	±0.004 °C (±0.007 °F)
IEC, MIL	Pt200	±0.02 °C (±0.036 °F)
	Pt500	±0.008 °C (±0.014 °F)
	Pt1000	±0.004 °C (±0.007 °F)
DIN 43760	Ni50	±0.008 °C (±0.014 °F)
	Ni100	±0.004 °C (±0.007 °F)
	Ni120	± 0.003 °C (± 0.005 °F)
	Ni1000	±0.004 °C (±0.007 °F)
OIML R 84	Cu10	±0,04 °C (±0.072 °F)
	Cu100	±0.004 °C (±0.007 °F)
Resistance measurement		
	0 to 500 Ω	±0.002 Ω
	0 to 5000 Ω	±0.02 Ω
Thermocouple, for all defined types		$\pm[(0.001 \% \times (ME[mV] / MS[mv]) + (100 \% \times (0.009 \text{ °C} / MS [\text{°C}])))^*$
Voltage measurement		
	-125 to 125 mV	±1.5 μV
	-125 to 1100 mV	±15 μV

\* ME = voltage value of the thermocouple at the upper range value in accordance with the standard

MA = voltage value of the thermocouple at the start of the measuring range in accordance with the standard

MS = voltage value of the thermocouple over the measuring span in accordance with the standard. MS = (ME - MA)

\*\* For the optional extended ambient temperature range of up to -50 °C (-58 °F), doubled influence values shall apply in the range of -50 to -40 °C (-58 to -40 °F).

## Electrical connections

### Resistance thermometers (RTD) / resistors (potentiometer)

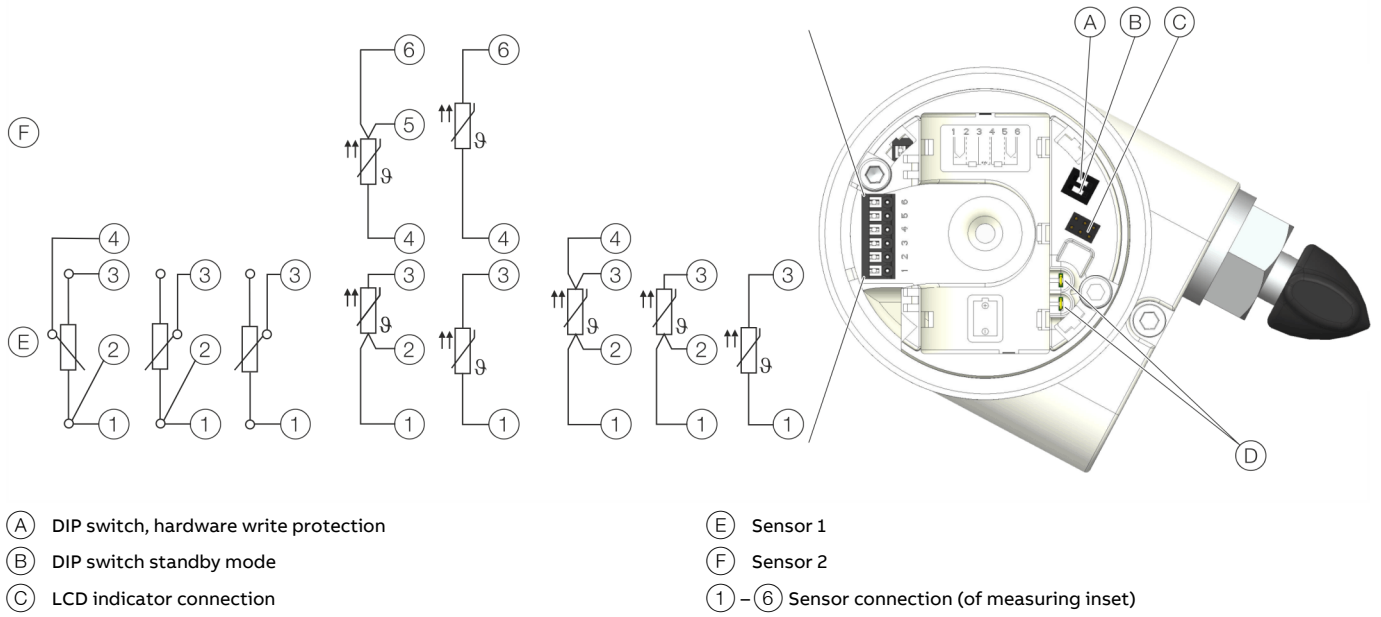


Figure 2: Terminal assignment resistance thermometer (RTD) / resistors (potentiometer)

### Thermocouples / voltages and resistance thermometer (RTD) / thermocouple combinations

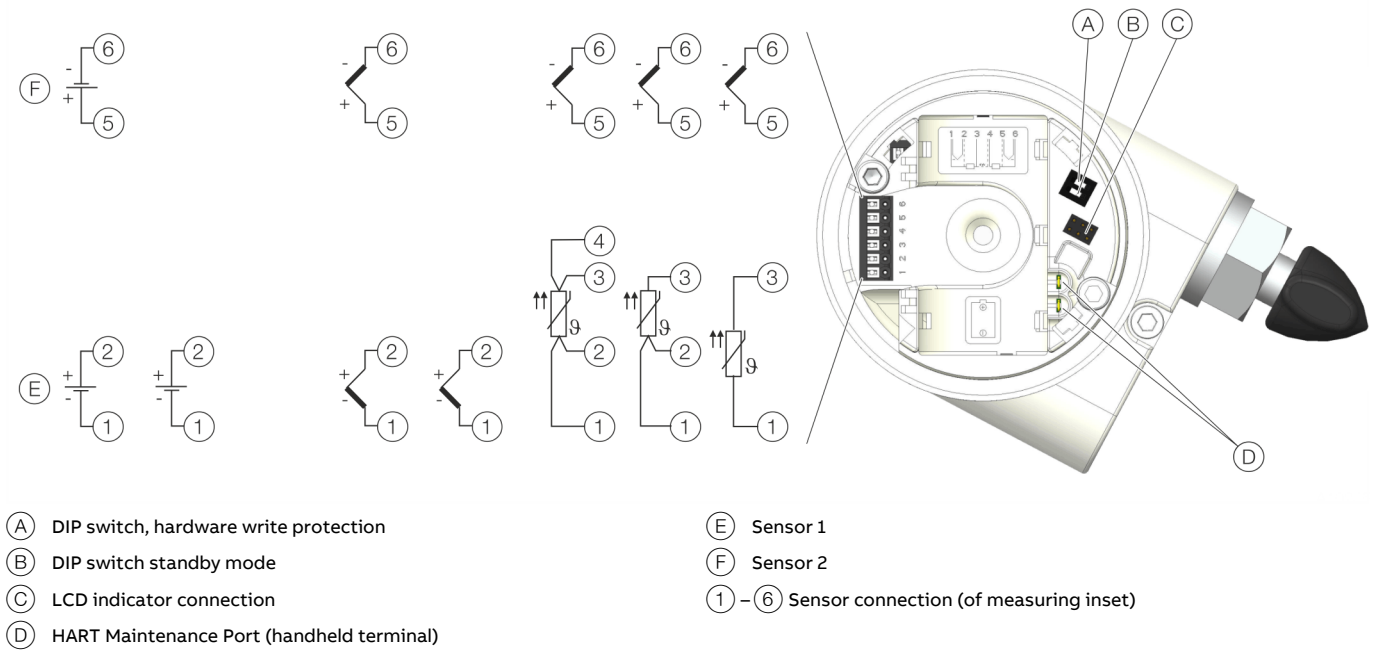


Figure 3: Terminal assignment thermocouples / voltages and resistance thermometer (RTD) / thermocouple combinations

## Communication

### Configuration parameters

- Sensor type, activation type
- Error signaling
- Measuring range
- General information, e.g. TAG number
- Damping
- Warning and alarm thresholds
- Output signal simulation
- Burst refresh rate
- Burst commands
- Network ID
- Join key
- Software write protection

### Diagnostic information in accordance with NE 107

#### Standard:

- Sensor error signalling  
(wire break or short circuit)
- Device error
- Limit value up-scale / down-scale
- Measuring range up-scale / down-scale
- Simulation active

#### Advanced:

- Sensor redundancy / sensor backup active  
(sensor failure)
- Drift monitoring
- Sensor / Sensor connection lead corrosion
- Drag indicator for Sensor 1, Sensor 2 and ambient temperature
- Ambient temperature up-scaled
- Ambient temperature down-scaled
- Operating hours counter
- Wireless interface error
- Connection status
- Battery status

### WirelessHART

The device is listed with the FieldComm Group.

Manufacturer-ID	0x1A
Device-ID	0x9B
Profile	HART® 7.5
Network ID	0xABB (2747 dec.)
Join Key	0x57495245 0x4c455353 0x4649454c 0x444b4559
Configuration	On device using LCD indicator DTM EDD

0x = hexadecimal

#### NOTICE

For data security reasons, we highly recommend that you change parameters Network ID and Join Key during commissioning.

#### Standard Burst Configuration

##### Burst message 1

HART® command	9 'device variables with status' PV, SV, TV, QV, battery life (days)
Update rate	16 seconds

##### Burst message 2

HART® command	48 'extended device status'
Update rate	32 seconds



**Dimensions**

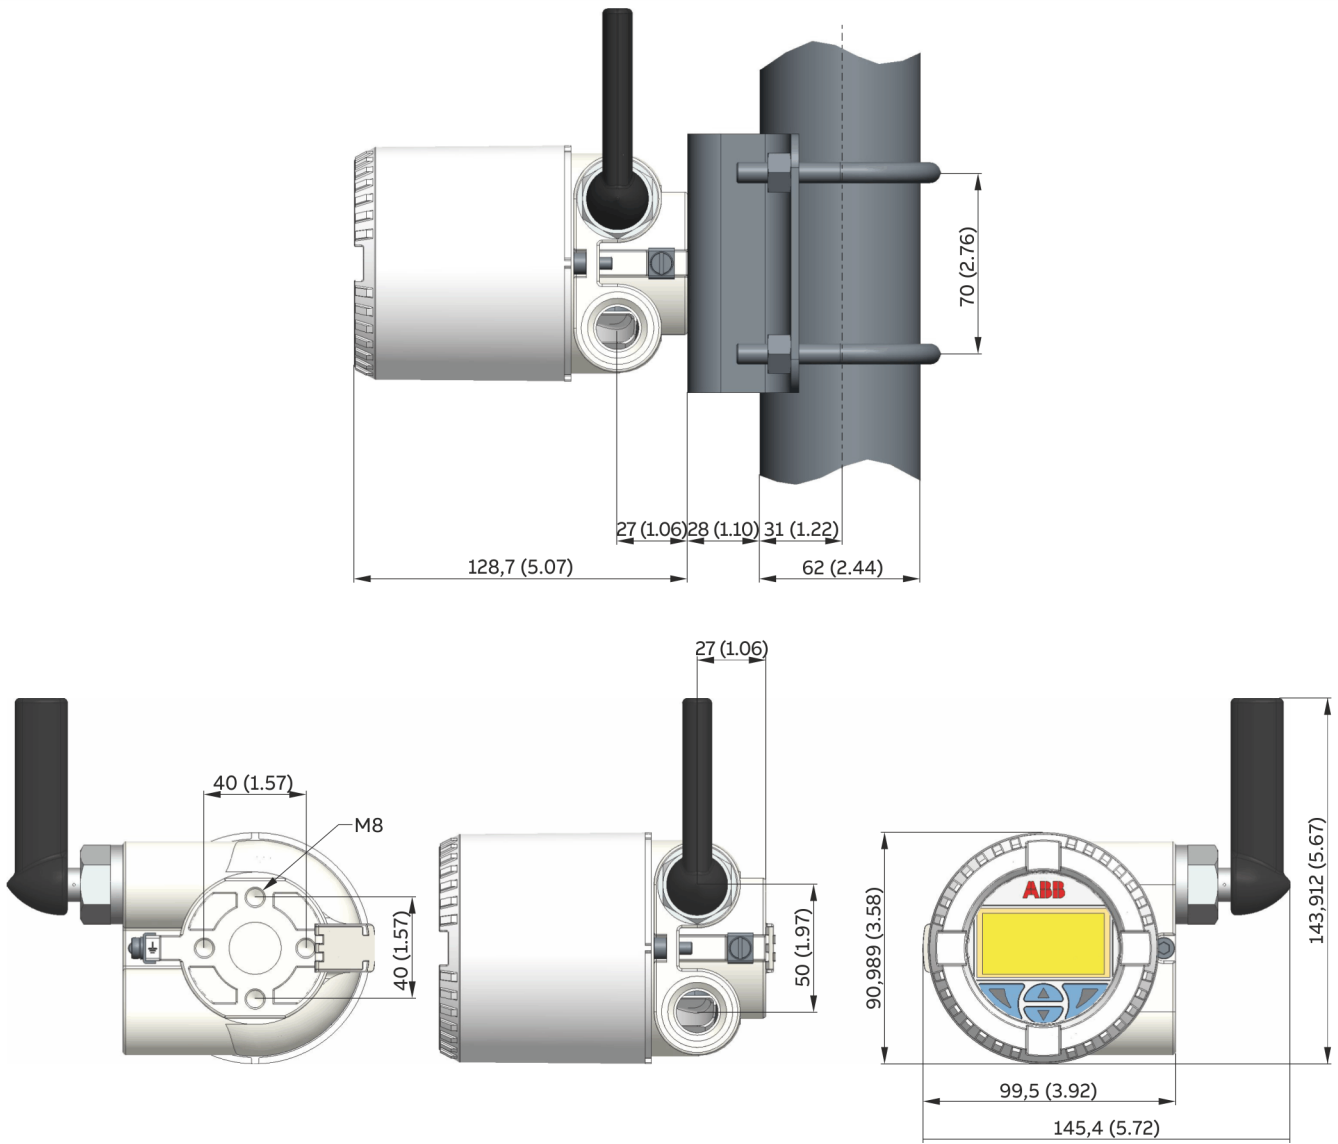


Figure 4: Dimensions in mm (in)

---

## Wireless operation approvals

### Telecommunications directive

Any device used for wireless applications must be certified in accordance with the telecommunications directives applicable for the operating location. This certification is country-specific. Before commissioning, you must make sure that local restrictions are complied with.

### European directives

Radio Equipment Directive 2014/53/EU

Within Europe, use of the 2400 - 2483.5 MHz frequency band is not harmonized. Country-specific regulations must therefore be observed.

### Restrictions for Norway

Operation not permitted within a radius of 20 km around Ny-Alesund in Svalbard. For more information, see [www.npt.no](http://www.npt.no), the Norway Posts and Telecommunications website.

### USA / Canada directives

FCC Part 15.247:2009 (USA)

IC RSS-210 and ICES-003 (Canada)

## Use in potentially explosive atmospheres in accordance with ATEX and IECEx

### Note

- Further information on the approval of devices for use in potentially explosive atmospheres can be found in the explosion protection test certificates (at [www.abb.com/wirelessmeasurement](http://www.abb.com/wirelessmeasurement)).
- Depending on the design, a specific marking in accordance with ATEX or IECEx applies.

### Ex marking

#### Transmitter

Model TTF300-W-A6..., TTF300-W-H6...

(Transmitter in zone 0, 1 or 2)

ATEX	IECEx
II 1 G Ex ia IIC T4...T1 Ga	Ex ia IIC T4...T1 Ga
Certificate no.:	Certificate no.:
PTB 14 ATEX 2010X	PTB 15.0009X

- The transmitter and the connected temperature sensor may be used fully in zone 0, zone 1 or zone 2.
- The temperature range corresponds to the information in **Temperature data** on page 11

#### LCD indicator

The device is supplied with or without an LCD indicator (order option "Housing / Indicators").

The LCD indicator has the following certificates:

ATEX	IECEx
Certificate no.:	Certificate no.:
PTB 05 ATEX 2079X	IECEx PTB 12.0028X

### Temperature data

Standard design in potentially explosive atmospheres

#### Ambient temperature range $T_{amb}$ .

Zone 1 -40 ... +70 °C (-40 ... +158 °F)

Zone 0 T4: -40 ... +43 °C (-40 ... +110 °F)  
(With consideration of EN1127- T1 ... T3: -40 ... +70 °C (-40 ... +158 °F)  
1)

"Extended ambient temperature range (order option SE)"  
design in potentially explosive atmospheres

#### Ambient temperature range $T_{amb}$ .

Zone 1 -50 ... +70 °C (-58 ... +158 °F)

Zone 0 T4: -50 ... +43 °C (-58 ... +110 °F)  
(With consideration of EN1127- T1 ... T3: -50 ... +70 °C (-58 ... +158 °F)  
1)

### Electrical data

#### Sensor inputs

	Resistance thermometer, resistors	Thermocouples, voltages
Maximum voltage	$U_{oWi} = 5,4 \text{ V}$	$U_o = 1,2 \text{ V}$
Short-circuit current	$I_o = 25 \text{ mA}$	$I_o = 50 \text{ mA}$
Maximum power	$P_o = 34 \text{ mW}$	$P_o = 60 \text{ mW}$
Internal inductance	$L_i = 0 \text{ mH}$	$L_i = 0 \text{ mH}$
Internal capacitance	$C_i = 49 \text{ nF}$	$C_i = 49 \text{ nF}$
Maximum permissible external inductance IIC	$L_o = 5 \text{ mH}$	$L_o = 5 \text{ mH}$
Maximum permissible external capacitance IIC	$C_o = 2,25 \mu\text{F}$	$C_o = 1,45 \mu\text{F}$

#### HART Maintenance Port

	HART Maintenance Port on TTF300-W	Maximum external connection values
Maximum voltage	$U_o = 5,4 \text{ V}$	$U_i = 2,6 \text{ V}$
Short-circuit current	$I_o = 25 \text{ mA}$	$I_i = 25 \text{ mA}$
Maximum power	$P_o = 34 \text{ mW}$	—
Inductance	$L_i = 0 \text{ mH}$	$L_o = 1 \text{ mH}$ (IIC)
Capacitance	$C_i = 1,2 \mu\text{F}$	$C_o = 0,4 \mu\text{F}$ (IIC)

## Use in potentially explosive atmospheres in accordance with cFMus

### Note

- Further information on the approval of devices for use in potentially explosive atmospheres can be found in the explosion protection test certificates (at [www.abb.com/wirelessmeasurement](http://www.abb.com/wirelessmeasurement)).
- Depending on the design, a specific marking in accordance with cFMus applies.

### Transmitter Ex marking

#### FM USA Intrinsically Safe

---

##### Model TTF300-W-L9

---

Control Drawing	3KXT221300B0001
-----------------	-----------------

Class I, Div. 1, Groups A, B, C, D T4

Class I, Zone 0, AEx ia IIC T4

---

#### FM Canada Intrinsically Safe

---

##### Model TTF300-W-R9

---

Control Drawing	3KXT221300B0001
-----------------	-----------------

Class I, Div. 1, Groups A, B, C, D T4

Class I, Zone 0, Ex ia IIC T4

---

## Ordering Information

### Ordering information TTF300-W

Base model	TTF300-W	XX	X	X	X	XX
TTF300-W Field Mounted Temperature Transmitter, WirelessHART						
<b>Explosion Protection</b>						
Without explosion protection		Y0				
ATEX Intrinsic Safety type of protection: Zone 0: II 1 G Ex ia IIC T4		A6				
IECEX Intrinsic Safety type of protection: Zone 0: Ex ia IIC T4		H6				
FM US Intrinsic Safety type of protection: Class I, DIV 1, Groups A, B, C, D, T4. Class I, Zone 0, AEx ia IIC T4		L9				
FM CA Intrinsic Safety type of protection: Class I, DIV 1, Groups A, B, C, D, T4, Class I, Zone 0, Ex ia IIC T4		R9				
<b>Housing / Indicator</b>						
Single-compartment housing (aluminum) / Without indicator			A			
Single-compartment housing (stainless steel) / Without indicator			B			
Single-compartment housing (aluminum) / With LCD indicator HMI			C			
Single-compartment housing (stainless steel) / With LCD indicator HMI			D			
<b>Cable Entry</b>						
Thread 1 × M20 × 1.5				5		
Thread 1 × ½ in NPT				6		
Thread 1 × ¾ in NPT, via ½ in > ¾ adapter, only available with Housing (aluminum)				7		
Cable gland 1 × M20 × 1.5 (limited temperature range)				8		
<b>Communication Protocol</b>						
WirelessHART					W	
<b>Configuration</b>						
Standard configuration						BS
Customer-specific configuration, except user curve						BF*
Customer-specific configuration, including user curve						BG

\* E.g. set measuring range, TAG no.

## ... Ordering Information

### Additional ordering information TTF300-W

	XX	XX	XXX	XX	XX	XX	XX	XX	XX
<b>Certificates</b>									
Declaration of compliance with the order 2.1 acc. EN 10204	C4								
Inspection certificate 3.1 acc. EN 10204 of visual, dimensional and functional test	C6								
<b>Calibration Certificates</b>									
With 5-point factory certificate		EM							
Inspection certificate 3.1 acc. EN 10204 of 5-point calibration		EP							
<b>Handling of Certificates</b>									
Send via e-mail			GHE						
Send via mail			GHP						
Send via mail express			GHD						
Send with instrument			GHA						
Only archived			GHS						
<b>Mounting Bracket</b>									
Wall mounting / 2 in. pipe mounting bracket (stainless steel)				K2					
<b>Extended Ambient Temperature Range</b>									
-50 to 85 °C (-58 to 185 °F)					SE				
<b>Device Identification Plate</b>									
Stainless steel							T0		
<b>Additional Tag Plate</b>									
Stainless steel								I1	
<b>Customer-specific Versions</b>									
(Please specify)									Z9
<b>Documentation Language</b>									
German									M1
English									M5
Language package Western Europe / Scandinavia (Languages: DA, ES, FR, IT, NL, PT, FI, SV)									MW
Language package Eastern Europe (Languages: EL, CS, ET, LV, LT, HU, HR, PL, SK, SL, RO, BG)									ME

Accessories	Catalog No.
Lithium battery	3KXT000029U0000
TTF300-W commissioning instruction, German	3KXT221300R4403
TTF300-W commissioning instruction, English	3KXT221300R4401
TTF300-W commissioning instruction, Language package Western Europe / Scandinavia	3KXT221300R4493
TTF300-W commissioning instruction, Language package Eastern Europe	3KXT221300R4494
TTF300-W documentation CD-ROM	3KXT221300R0800

## Trademarks

WirelessHART is a registered trademark of FieldComm Group, Austin, Texas, USA

## Order form configuration

### WirelessHART: Data relating to customer-specific configuration

Configuration	Selection
Number of sensors	<input type="checkbox"/> 1 sensor (standard) <input type="checkbox"/> 2 sensors
Measurement type (for 2-sensor selection only)	<input type="checkbox"/> Sensor redundancy / sensor backup <input type="checkbox"/> Sensor drift monitoring ___°C / K sensor drift difference ___s time limit for drift overshoot <input type="checkbox"/> Difference measurement <input type="checkbox"/> Average measurement
IEC 60751 Resistance thermometer	<input type="checkbox"/> Pt10 <input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100 (Standard) <input type="checkbox"/> Pt200 <input type="checkbox"/> Pt500 <input type="checkbox"/> Pt1000
JIS C1604-89	<input type="checkbox"/> Pt10 <input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100
MIL-T-24388	<input type="checkbox"/> Pt10 <input type="checkbox"/> Pt50 <input type="checkbox"/> Pt100 <input type="checkbox"/> Pt200 <input type="checkbox"/> Pt1000
DIN 43760	<input type="checkbox"/> Ni50 <input type="checkbox"/> Ni100 <input type="checkbox"/> Ni120 <input type="checkbox"/> Ni1000
Cu	<input type="checkbox"/> Cu10 <input type="checkbox"/> Cu100
Resistance measurement	<input type="checkbox"/> 0 to 500 Ω <input type="checkbox"/> 0 to 5000 Ω
IEC 60584 Thermocouple	<input type="checkbox"/> Type K <input type="checkbox"/> Type J <input type="checkbox"/> Type N <input type="checkbox"/> Type R <input type="checkbox"/> Type S <input type="checkbox"/> Type T <input type="checkbox"/> Type E <input type="checkbox"/> Type B
DIN 43710	<input type="checkbox"/> Type L <input type="checkbox"/> Type U
ASTM E-988	<input type="checkbox"/> Type C <input type="checkbox"/> Type D
Voltage measurement	<input type="checkbox"/> -125 to 125 mV <input type="checkbox"/> -125 to 1100 mV
Sensor connection type (for resistance thermometer and resistance measurement only)	<input type="checkbox"/> Two-wire <input type="checkbox"/> Three-wire (standard) <input type="checkbox"/> Four-wire Two-wire circuit: Compensation of sensor-wire resistance max. 100 Ω <input type="checkbox"/> Sensor 1: ___ Ω <input type="checkbox"/> Sensor 2: ___ Ω
Reference junction (for thermocouples only)	<input type="checkbox"/> Internal (for standard thermocouple, except type B) <input type="checkbox"/> None (type B) <input type="checkbox"/> External / temperature: ___°C
Unit	<input type="checkbox"/> Celsius (default) <input type="checkbox"/> Fahrenheit <input type="checkbox"/> Rankine <input type="checkbox"/> Kelvin
Sensor number	<input type="checkbox"/> Sensor 1: _____ <input type="checkbox"/> Sensor 2: _____
Resistor value at 0 °C / R <sub>0</sub>	Sensor 1: R <sub>0</sub> : _____ Sensor 2: R <sub>0</sub> : _____
Callendar-Van Dusen coefficient A	A: _____ A: _____
Callendar-Van Dusen coefficient B	B: _____ B: _____
Callendar-Van Dusen coefficient C	C: _____ C: _____
(optional, for resistance thermometers only)	
User characteristics based on linearization table	<input type="checkbox"/> Based on attached table of variate pairs
Software write protection	<input type="checkbox"/> Off (standard) <input type="checkbox"/> On
TAG number	<input type="checkbox"/> _____
Long TAG number	<input type="checkbox"/> _____
Network ID	<input type="checkbox"/> Hexadecimal value ABB standard or _____
Join key	<input type="checkbox"/> Hexadecimal value ABB standard or _____ <input type="checkbox"/> Hexadecimal value ABB standard or _____ <input type="checkbox"/> Hexadecimal value ABB standard or _____ <input type="checkbox"/> Hexadecimal value ABB standard or _____
Burst message 1	HART command <input type="checkbox"/> 3 'Dynamic HART variables' <input type="checkbox"/> 9 'Device variables with status' (ABB-Standard)
Update rate	<input type="checkbox"/> 4 seconds <input type="checkbox"/> 8 seconds <input type="checkbox"/> 16 seconds <input type="checkbox"/> 32 seconds <input type="checkbox"/> 60 to 3600 seconds _____

---

**ABB Limited****Measurement & Analytics**

Howard Road, St. Neots  
Cambridgeshire, PE19 8EU  
UK

Tel: +44 (0)870 600 6122

Fax: +44 (0)1480 213 339

Email: [enquiries.mp.uk@gb.abb.com](mailto:enquiries.mp.uk@gb.abb.com)

**ABB Inc.****Measurement & Analytics**

125 E. County Line Road  
Warminster, PA 18974  
USA

Tel: +1 215 674 6000

Fax: +1 215 674 7183

**ABB Automation Products GmbH****Measurement & Analytics**

Schillerstr. 72  
32425 Minden  
Germany

Tel: +49 571 830-0

Fax: +49 571 830-1806

[abb.com/wirelessmeasurement](http://abb.com/wirelessmeasurement)

---

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.