

## Technical Information

**STG73P SmartLine Flush Mount Gauge Pressure Specification 34-ST-03-108, Jan 2022****Introduction**

Part of the SmartLine® family of products, the STG73P is a gauge pressure transmitter with a flush mounted diaphragm. Installed using a 1" sleeve welded to the process piping the diaphragm face may be situated flush with the process piping wall. Typically applied to applications such as head boxes in pulp and paper mills, flush mounting eliminates the possibility of clogging. In addition, the transmitter mounting facilitates rapid and trouble free replacement. The SmartLine family is also fully tested and compliant with Experion® PKS providing the highest level of compatibility assurance and integration capabilities. SmartLine easily meets the most demanding application needs for pressure measurement applications.

**Best in Class Features:**

- Flush mounting design.
- Accuracies up to 0.065 % of span standard & 0.04% of span optional
- Stability up to 0.020% of URL per year for 10 years
- Automatic temperature compensation
- Rangeability up to 100:1
- Response times as fast as 100ms
- Alphanumeric display capabilities
- External zero, span, & configuration capability
- Polarity insensitive electrical connections
- Comprehensive on-board diagnostic capabilities
- Integral Dual Seal design for safety based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.0
- Full compliance to SIL 2/3 requirements
- Modular design characteristics
- Available with additional 4-year warranty

**Span & Range Limits:**

Model	URL/Max Span psig (barg)	LRL psig (barg)	Min Span
STG73P	100 (7.0)	-14.7 (-1.0)	1 (0.07)



**Figure 1 – STG73P Flush Mount Gauge Pressure Transmitters feature field-proven piezoresistive sensor technology**

**Communications/Output Options:**

- Honeywell Digitally Enhanced (DE)
- HART® (version 7.0)
- FOUNDATION™ Fieldbus

All transmitters are available with the above listed communications protocols.

## Description

The SmartLine family pressure transmitters are designed around a high performance piezo-resistive sensor. This one sensor actually integrates multiple sensors linking process pressure measurement with on-board static pressure (DP Models) and temperature compensation measurements. This level of performance allows the ST 700 to replace most competitive transmitters available today.

## Indication/Display Option

The ST 700 modular design accommodates a basic alphanumeric LCD display.

### Basic Alphanumeric LCD Display Features

- Modular (may be added or removed in the field)
- 0, 90, 180, & 270 degree position adjustments
- Configurable and standard (Pa, KPa, MPa, KGcm<sup>2</sup>, Torr, ATM, inH<sub>2</sub>O, mH<sub>2</sub>O, bar, mbar, inH<sub>2</sub>O, inHG, FTH<sub>2</sub>O, mmH<sub>2</sub>O, mm HG, & psi) measurement units
- 2 Lines 16 Characters (4.13H x 1.83W mm)
- Square root output indication ( $\sqrt{}$ )

### Simple LCD Display Features

- Modular (may be added or removed in the field)
- Supports HART protocol variant
- 0, 90, 180, & 270 degree position adjustments
- Configurable (HART only) and standard (Pa, KPa, MPa, KGcm<sup>2</sup>, Torr, ATM, inH<sub>2</sub>O, mH<sub>2</sub>O, bar, mbar, inH<sub>2</sub>O, inHG, FTH<sub>2</sub>O, mmH<sub>2</sub>O, mm HG, & psi) measurement units.
- Supports Flow engineering units
- 2 Lines 6 digits PV (9.95H x 4.20W mm) 8 Characters
- Square root output indication ( $\sqrt{}$ ) and Write protect Indication
- Built in Basic Device Configuration through Internal Buttons – Range/Engineering Unit/Loop Test /Loop Calibration/Zero /Span Setting

## Diagnostics

SmartLine transmitters all offer digitally accessible diagnostics which aid in providing advanced warning of possible failure events minimizing unplanned shutdowns, providing **lower overall operational costs**

## System Integration

- SmartLine communications protocols all meet the most current published standards for HART/DE/Fieldbus.
- Integration with Honeywell's Experion PKS offers the following unique advantages.
  - Tamper reporting
  - FDM Plant Area Views with Health summaries
  - All ST 700 units are Experion tested to provide the highest level of compatibility assurance

## Configuration Tools

### External Three Button Configuration Option

Suitable for all electrical and environmental requirements, SmartLine offers the ability to configure the transmitter and display via three externally accessible buttons when a display option is selected. Zero/span capabilities are also optionally available via these buttons with or without selection of the display option.

### Internal Two Button Configuration Option

The Simple display has two buttons that can be used for Basic configuration such as re ranging, PV Engineering unit setting, Zero/Span settings and Loop testing and calibration functions.

### Handheld Configuration

SmartLine transmitters feature two-way communication and configuration capability between the operator and the transmitter. All Honeywell transmitters are designed and tested for compliance with the offered communication protocols and are designed to operate with any standards compliant handheld configuration device.

### Personal Computer Configuration

Honeywell's SCT 3000 Configuration Toolkit provides an easy way to configure Digitally Enhanced (DE) instruments using a personal computer as the configuration interface. Field Device Manager (FDM) Software and FDM Express are also available for managing HART & Fieldbus device configurations.

### Modular Design

To help contain maintenance & inventory costs, all ST 700 transmitters are modular in design supporting the user's ability to replace meter bodies, add indicators or change electronic modules without affecting overall performance or approval body certifications. Each meter body is uniquely characterized to provide in-tolerance performance over a wide range of application variations in temperature and pressure and due to the Honeywell advanced interface, electronic modules may be swapped with any electronics module without losing in-tolerance performance characteristics.

### Modular Features

- Meter body replacement
- Exchange/replace electronics/comms modules\*
- Add or remove integral indicator\*
- Add or remove lightning protection (terminal connection)\*

\* Field replaceable in all electrical environments (including IS) except flameproof without violating agency approvals.

With no performance effects, Honeywell's unique modularity results in **lower inventory needs and lower overall operating costs**.

## Performance Specifications

**Reference Accuracy:** (conformance to +/-3 Sigma)

Table 1

Model	URL	LRL	Min Span	Maximum Turndown Ratio	Stability (% URL/Year for 10 years)	Reference Accuracy <sup>1,2</sup> (% Span) Standard/optional
STG73P	100 psi (7.0 bar)	-14.7 psi (-1.0 bar)	1.0 psi (0.07 bar)	100:1	0.02	0.065 / 0.040

Zero and span may be set anywhere within the listed (URL/LRL) range limits

**Accuracy, Span and Temperature Effect:** (conformance to +/-3 Sigma)

Table 2

			Accuracy <sup>1,2</sup> (% of Span)				Combined Zero & Span temperature Effect (% Span / 28°C (50 F))	
	Model	URL	Reference Turndown	A	B	C (see URL units)	D	E
Standard Accuracy	STG73P	100 psi (7.0 bar)	5:1	0.005	0.060	20 (1.4)	0.050	0.050
High Accuracy option	STG73P	100 psi (7.0 bar)	5:1	0.005	0.035	20 (1.4)	0.050	0.050
Turn Down Effect						Temp Effect		
$\pm [A + B] \text{ if } \text{Span} \geq C$ $\pm \left[ A + B \left( \frac{C}{\text{Span}} \right) \right] \text{ if } \text{Span} < C$						$\pm [D + E \left( \frac{\text{URL}}{\text{Span}} \right)]$		

**Total Performance (% of Span):**

$$\text{Total Performance Calculation: } = +/- \sqrt{(\text{Accuracy})^2 + (\text{Temperature Effect})^2}$$

**Total Performance Examples (for comparison):** standard accuracy, @ 5:1 Turndown, +/-50 °F (28°C) shift

**STG73P @20 psi:** 0.307% of span

**Typical Calibration Frequency:**

Calibration verification is recommended every two (2) years

**Notes:**

1. Terminal based Accuracy – Includes combined effects of linearity, hysteresis and repeatability. Analog output adds 0.005% of span
2. For zero based spans and reference conditions of 25°C (77°F), for LRV>= 0 psia, 10 to 55% RH

## Operating Conditions – All Models

Parameter	Reference Condition		Rated Condition		Operative Limits		Transportation and Storage							
	°C	°F	°C	°F	°C	°F	°C	°F						
Ambient Temperature <sup>1</sup>	25±1	77±2	-15 to 65	5 to 149	-15 to 65	5 to 149	-55 to 75	-67 to 167						
Process Interface Temperature	25±1	77±2	-15 to 65	5 to 149	-15 to 95 <sup>2</sup>	5 to 203	N/A	N/A						
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100							
Vac. Region – Min. Pressure mmHg absolute inH <sub>2</sub> O absolute	Atmospheric Atmospheric		300 150		2 (short term) <sup>3</sup> 1 (short term) <sup>3</sup>									
Supply Voltage Load Resistance	HART: 10.8 to 42.4 VDC at terminals (IS versions limited to 30 VDC), 0 to 1,440 ohms DE: 15 to 49.3VDC at terminals (IS versions limited to 30VDC), 0 to 1,200 ohms (as shown in Figure 2) FOUNDATION Fieldbus: 9.0 to 32.0 VDC at terminals, steady state current: 17.6mA, software download current: 27.4mA													
Maximum Allowable Working Pressure (MAWP) <sup>4,5</sup>  (ST700 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	STG73P: 100 psi (7.0 bar)													


<sup>1</sup> LCD Display Storage temperature lower limit is -30°C.

<sup>2</sup> Process temperatures above 65°C (149°F) require a 1:1 reduction in maximum ambient temperature.

<sup>3</sup> Short term equals 2 hours at 70°C (158°F)

<sup>4</sup> Units can withstand overpressure of 1.5 x MAWP without damage

<sup>5</sup> Consult factory for MAWP of ST 700 transmitters with CRN approval

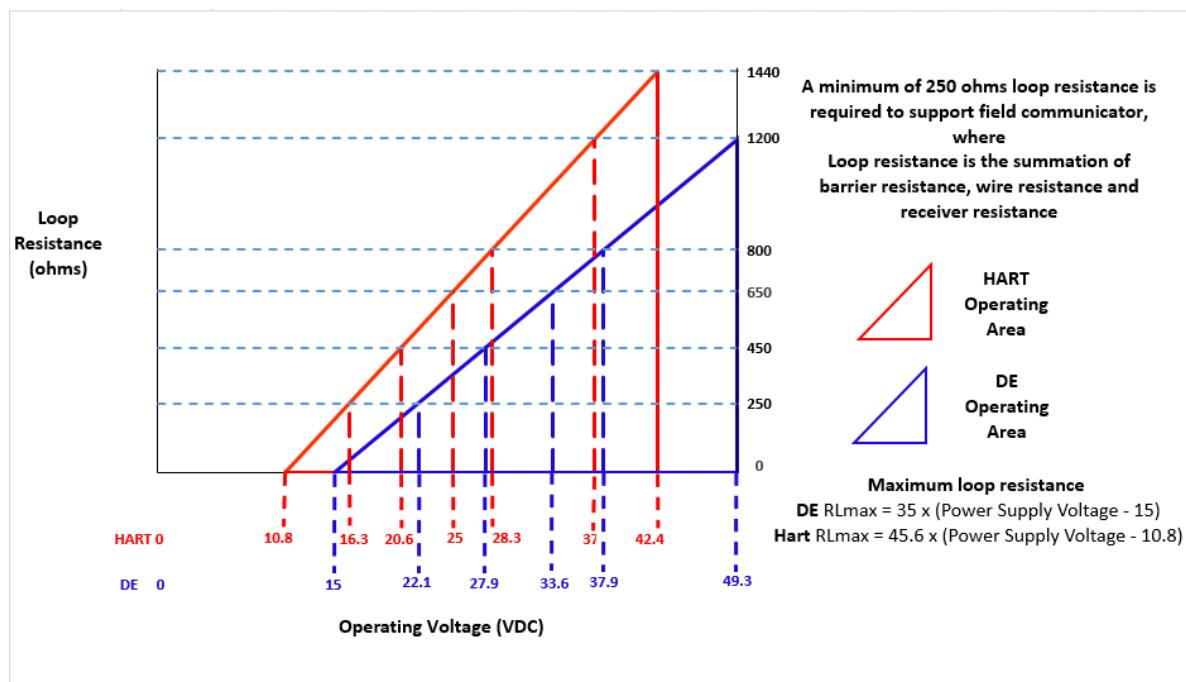

**Figure 2 - Supply voltage and loop resistance chart & calculations****Performance Under Rated Conditions – All Models**

Parameter	Description	
<b>Analog Output</b>	Two-wire, 4 to 20 mA (HART & DE Transmitters only)	
<b>Digital Communications:</b>	Honeywell DE, HART protocol or FOUNDATION Fieldbus ITK 6.0.1 compliant All transmitters, irrespective of protocol have polarity insensitive connection.	
<b>Output Failure Modes</b> (configurable)	<b>Honeywell Standard</b> <b>Normal Limits:</b> 3.8 – 20.8 mA <b>NAMUR NE 43 Compliance</b> <b>Failure Mode:</b> ≤ 3.6 mA and ≥ 21.0 mA      3.8 – 20.5 mA ≤ 3.6 mA and ≥ 21.0 mA	
<b>Supply Voltage Effect</b>	0.005% span per volt.	
<b>Transmitter Turn on Time</b> (includes power up & test algorithms)	HART or DE: 2.5 seconds Foundation Fieldbus: host dependent	
<b>Response Time</b> (delay + time constant)	<b>DE/HART Protocol</b> 100ms	<b>FOUNDATION Fieldbus</b> 150ms (Host Dependent)
<b>Damping Time Constant</b>	<b>HART:</b> Adjustable from 0 to 32 seconds in 0.1 increments. <b>Default Value:</b> 0.5 seconds <b>DE:</b> Discrete values 0, 0.16, 0.32, 0.48, 1, 2, 4, 8, 16, 32 seconds. <b>Default Value:</b> 0.48 seconds	
<b>Vibration Effect:</b>	Less than +/- 0.1% of URL w/o damping Per IEC60770-1 field or pipeline, high vibration level (10-2000Hz: 0.21 displacement/3g max acceleration)	
<b>Electromagnetic Compatibility</b>	IEC 61326-3-1	
<b>Lightning Protection Option</b>	<b>Leakage Current:</b> 10uA max @ 42.4VDC 93C <b>Impulse rating:</b> 8/20us      5000A (>10 strikes)      10000A (1 strike min.) 10/1000us      200A (> 300 strikes)	

**Materials Specifications** (see model selection guide for availability/restrictions with various models)

Parameter	Description
<b>Process Diaphragms (wetted)</b>	Hastelloy® C-276 <sup>2</sup>
<b>Meter Body Materials (wetted)</b>	316L Stainless Steel
<b>Process Seal</b>	Viton® O-ring
<b>Fill Fluid</b>	Silicone oil 200
<b>Mounting Bracket</b>	Carbon Steel (Zinc-Chromate plated) or 304 Stainless Steel or 316 Stainless Steel.. See Figures 4 & 5
<b>Electronic Housing</b>	Pure Polyester Powder Coated Low Copper (<0.4%)-Aluminum. Meets NEMA 4X, IP66, IP67 and NEMA 7 (explosion proof). All stainless steel housing is optional.
<b>Process Connection Type</b>	<b>STG73P:</b> Flush mount in 1" sleeve with O-ring and locking bolt.
<b>Wiring</b>	Accepts up to 16 AWG (1.5 mm diameter).
<b>Dimensions</b>	See Figures 4
<b>Net Weight</b>	<b>STG73P:</b> 3.9 pounds (1.8 Kg) with Aluminum Housing

<sup>2</sup> Hastelloy® C-276 or UNS N10276

## Communications Protocols & Diagnostics

### HART Protocol

**Version:**

HART 7

### Foundation Fieldbus (FF)

#### Available Function Blocks

Block Type	Qty	Execution Time
Resource	1	n/a
Transducer	1	n/a
Diagnostic	1	n/a
Analog Input	1*	30 ms
PID w/Autotune	1	45 ms
Integrator	1	30 ms
Signal Char (SC)	1	30 ms
LCD Display	1	n/a
Flow Block	1	30 ms
Input Selector	1	30 ms
Arithmetic	1	30 ms

\* AI block may have two (2) additional instantiations.

All available function blocks adhere to FOUNDATION Fieldbus standards. PID blocks support ideal & robust PID algorithms with full implementation of Auto-tuning.

### Link Active Scheduler

Transmitters can perform as a backup Link Active Scheduler and take over when the host is disconnected. Acting as a LAS, the device ensures scheduled data transfers typically used for the regular, cyclic transfer of control loop data between devices on the Fieldbus.

### Number of Devices/Segment

Entity IS model: 6 devices/segment

### Schedule Entries

18 maximum schedule entries

### Number of VCR's: 24 max

**Compliance Testing:** Tested according to ITK 6.0.1

### Software Download

Utilizes Class-3 of the Common Software Download procedure as per FF-883 which allows the field devices of any manufacturer to receive software upgrades from any host.

### Honeywell Digitally Enhanced (DE)

DE is a Honeywell proprietary protocol which provides digital communications between Honeywell DE enabled field devices and Hosts.

### Standard Diagnostics

ST 700 top level diagnostics are reported as either critical or non-critical and readable via the DD/DTM tools or integral display as shown

### Critical Diagnostics

HART DD/DTM Tools	Basic Display	Simple Display
Electronic Module DAC Failure	Electronics module fault	Fault Comm EI
Meter Body NVM Corrupt	Meter Body fault	Fault Mtrbody
Config. Data Corrupt	Electronics module fault	Fault Comm EI
Electronic Module Diag Failure	Electronics module fault	Fault Comm EI
Meter Body Critical Failure	Meter Body fault	Fault Mtrbody
Sensor Comms Timeout	Meter Body Comm fault	Fault Mbd Com

### Non-Critical Diagnostics

HART DD/DTM Tools
Display Failure
Electronic Module Comm Failure
Meter Body Excess Correct
Sensor Over Temperature
Fixed Current Mode
PV Out of Range
No Factory Calibration
No DAC Compensation
LRV Set Error – Zero Config. Button
URV Set Error – Zero Config. Button
AO Out of Range
Loop Current Noise
Meter Body Unreliable Comm
Tamper Alarm,
No DAC Calibration
Sensor Supply Voltage Low

## Hazardous Areal Certifications:

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
A	FM Approvals™ USA	<b>Explosionproof:</b> Class I, Division 1, Groups A, B, C, D; Dust Ignition Proof: Class II, III, Division 1, Groups E, F, G; T6..T5 Class I, Zone 0/1, AEx db IIC T6..T5 Ga/Gb Class II, Zone 21, AEx tb IIIC T95° Db	All	Note 1	T5: -50 °C to 85°C T6: -50 °C to 65°C
		<b>Intrinsically Safe:</b> Class I, II, III, Division 1, Groups A, B, C, D, E, F, G; T4 Class I, Zone 0, AEx ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
			Foundation Fieldbus	Note 2b	-50 °C to 70°C
		<b>Nonincendive:</b> Class I, Division 2, Groups A, B, C, D locations, T4 Class I, Zone 2, AEx nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
		<b>Enclosure:</b> Type 4X/ IP66/ IP67	All	All	-
<b>STANDARDS:</b> FM Class 3600:2011; FM Class 3610: 2010; FM Class 3611: 2004; FM Class 3615: 2006; FM Class 3616: 2011; FM Class 3810: 2005; ANSI/ISA 60079-0: 2013; ANSI/UL 60079-1: 2015; ANSI/UL 60079-11: 2014; ANSI/ISA 60079-15: 2012; ANSI/UL 60079-26: 2017; ANSI/UL 60079-31: 2015; ANSI/NEMA 250: 2003; ANSI/ IEC 60529: 2004					
B	Canadian Standards Association (CSA) USA and Canada	<b>Explosion Proof:</b> Class I, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T6..T5 Class I Zone 1 AEx db IIC T6..T5 Ga/Gb Ex db IIC T6..T5 Ga/Gb Zone 22 AEx tb IIIC T95° Db Ex tb IIIC T95° Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Class I, II, III, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T4 Class I Zone 0, AEx ia IIC T4 Ga Class I Zone 2, AEx ic IIC T4 Gc Ex ia IIC T4 Ga Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Nonincendive:</b> Class I, Division 2, Groups A, B, C, D; Class II, Division 2, Groups F, G; Class III, Division 2, T4 Class I Zone 2 AEx nA IIC T4 Gc Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C to 85°C
		<b>Enclosure:</b> Type 4X/ IP66/ IP67	All	All	-
<b>STANDARDS:</b> CSA C22.2 No. 0-10; CSA C22.2 No. 94-M91; CSA C22.2 No. 25-1966; CSA C22.2 No. 30-M1986; CSA C22.2 No. 142-M1987; CSA C22.2 No. 157-92; CSA C22.2 No. 213-M1987;					

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
		CSA-C22.2 No. 60529:05; CSA-C22.2 No. 60079-0:11; CSA-C22.2 No. 60079-1:11; CSA-C22.2 No. 60079-11:11; CSA-C22.2 No. 60079-15:12; CSA-C22.2 No. 60079-31:12; ISA 12.12.01-2010; ISA 60079-0: 2009; ISA 60079-11: 2011; ISA 60079-15: 2009; ISA 60079-26: 2008; ISA-60079-27:2007 (12.02.04)-2006 (R2011); UL 913 Ed. 6; UL 916:1998; ANSI/ISA-12.27.01-2011			
C	ATEX	<b>Flameproof: SIRA 12ATEX2233X</b> II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe: SIRA 12ATEX2233X</b> II 1 G Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
		<b>Zone 2, Increase Safety: SIRA 12ATEX4234X</b> II 3 G Ex ec IIC T4 Gc	Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Zone 2, Intrinsically Safe: SIRA 12ATEX4234X</b> II 3 G Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) II 3 G Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		<b>Enclosure:</b> IP66/ IP67	All	All	-
		<b>STANDARDS:</b> EN 60079-0: 2012/A11: 2013; EN 60079-1: 2014; EN 60079-7: 2015; EN 60079-11: 2012; EN 60079-26: 2015; EN 60079-31: 2009			
D	IECEx World	<b>Flameproof: IECEx SIR 12.0100X</b> Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe: IECEx SIR 12.0100X</b> Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
		<b>Zone 2, Increase Safety: IECEx SIR 12.0100X</b> Ex ec IIC T4 Gc	Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Zone 2, Intrinsically Safe: IECEx SIR 12.0100X</b> Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		<b>Enclosure:</b> IP66/ IP67	All	All	-
		<b>STANDARDS:</b> IEC 60079-0: 2011; IEC 60079-1: 2014; IEC 60079-7: 2017; IEC 60079-11: 2011; IEC 60079-26: 2014; IEC 60079-31: 2013			

E	SAEx South Africa	<b>Flameproof :</b> Ex d IIC T6...T5 Ga/Gb Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Ex ia IIC Ga T4 FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Zone 2, Increase Safety:</b> II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		<b>Zone 2, Intrinsically Safe:</b> Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		<b>Enclosure:</b> IP66/ IP67	All	All	-
F	INMETRO Brazil	<b>Flameproof:</b> Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50°C TO 70°C
			Foundation Fieldbus	Note 2b	-50°C TO 70°C
		<b>Zone 2, Increase Safety:</b> II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		<b>Zone 2, Intrinsically Safe:</b> Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		<b>Enclosure :</b> IP 66/67	All	All	-
G	NEPSI CHINA	<b>Flameproof:</b> Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T 95°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Zone 2, Increase Safety:</b> II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		<b>Zone 2, Intrinsically Safe:</b> Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		<b>Enclosure :</b> IP 66/67	All	All	-

<b>H</b>	<b>KOSHA Korea</b>	<b>Flameproof :</b> Ex d IIC T4, T5, T6 Ex tD A21 IP66/IP67 T95°C...T120 °C	All	Note 1	T4: -50°C TO 85°C T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Ex ia IIC T4	4-20 mA / DE/ HART	Note 2	Ta= -50 °C to 70°C
			Foundation Fieldbus	Note 2	Ta= -50 °C to 70°C
		<b>Enclosure:</b> IP66/ IP67	All	All	-
<b>I</b>	<b>EAC Russia, Belarus and Kazakhstan</b>	<b>Flameproof:</b> Ga/Gb Ex d IIC T6..T5 Ex tb IIIC Db T 85°C	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Ga Ex ia IIC T4 X FISCO Field Device (Only for FF Option) Ga Ex ia IIC T4 X	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Zone 2, Non Sparking:</b> 2 Ex nA IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		<b>Zone 2, Intrinsically Safe:</b> Ga Ex ic IIC T4 X FISCO Field Device (Only for FF Option) 2 Ex ic IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		<b>Enclosure :</b> IP 66/67	All	All	-
<b>J</b>	<b>CCoE INDIA</b>	<b>Flameproof:</b> Ex d IIC T6..T5 Ga/Gb	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Non Sparking</b> Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		<b>Enclosure:</b> IP66/ IP67	All	All	-
<b>K</b>	<b>UATR UKRAINE</b>	<b>Flameproof:</b> II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		<b>Intrinsically Safe:</b> II 1 G Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		<b>Enclosure:</b> IP66/ IP67	All	All	-

Notes:

1. Operating Parameters:

Voltage = 11 to 42 VDC	Current = 4-20 mA Normal
= 10 to 30 V (FF)	= 30 mA (FF)

2. Intrinsically Safe Entity Parameters

a. Analog/DE/HART Entity Values

Vmax = Ui = 30V	I <sub>max</sub> = I <sub>i</sub> = 105mA	C <sub>i</sub> = 4.2nF	L <sub>i</sub> = 984 uH	P <sub>i</sub> = 0.9W
-----------------	---	------------------------	-------------------------	-----------------------

Transmitter with Terminal Block revision E or Later

Vmax = Ui = 30V	I <sub>max</sub> = I <sub>i</sub> = 225mA	C <sub>i</sub> = 4.2nF	L <sub>i</sub> = 0	P <sub>i</sub> = 0.9W
-----------------	---	------------------------	--------------------	-----------------------

Note: Transmitter with Terminal Block revision E or later

The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-001 or 50049839-002
- Second line has the supplier information, along with the REVISION:

XXXXXX-XXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION

b. Foundation Fieldbus Entity Values

Vmax = Ui = 30V	I <sub>max</sub> = I <sub>i</sub> = 180mA	C <sub>i</sub> = 0nF	L <sub>i</sub> = 984 uH	P <sub>i</sub> = 1W
-----------------	---	----------------------	-------------------------	---------------------

Transmitter with Terminal Block revision F or Later

Vmax = Ui = 30V	I <sub>max</sub> = I <sub>i</sub> = 225mA	C <sub>i</sub> = 0nF	L <sub>i</sub> = 0	P <sub>i</sub> = 1 W
-----------------	---	----------------------	--------------------	----------------------

**FISCO Field Device**

Vmax = Ui = 17.5V	I <sub>max</sub> = I <sub>i</sub> = 380 mA	C <sub>i</sub> = 0nF	L <sub>i</sub> = 0	P <sub>i</sub> = 5.32 W
-------------------	--	----------------------	--------------------	-------------------------

Note : Transmitter with Terminal Block revision For later

The revision is on the label that is on the module. There will be two lines of text on the label:

- First is the Module Part #: 50049839-003 or 50049839-004
- Second line has the supplier information, along with the REVISION:

XXXXXX-XXXX, THE "X" is production related, THE POSITION of the "E" IS THE REVISION

### Approval Certifications: (Continued)

<b>Marine Certificates</b>	This certificate defines the certifications covered for the ST 800 Pressure Transmitter family of products, including the SMV 800 Smart Multivariable Transmitter. It represents the compilation of the five certificates Honeywell currently has covering the certification of these products into marine applications.
	For SmartLine Pressure Transmitter and SMV800 Smart Multivariable Transmitter
	<b>American Bureau of Shipping (ABS)</b> - 2009 Steel Vessel Rules 1-1-4/3.7, 4-6-2/5.15, 4-8-3/13 & 13.5, 4-8-4/27.5.1, 4-9-7/13. Certificate number: 04-HS417416-PDA
	<b>Bureau Veritas (BV)</b> - Product Code: 389:1H. Certificate number: 12660/B0 BV
	<b>Det Norske Veritas (DNV)</b> - Location Classes: Temperature D, Humidity B, Vibration A, EMC B, Enclosure C. For salt spray exposure; enclosure of 316 SST or 2-part epoxy protection with 316 SST bolts to be applied. Certificate number: A-11476
	<b>Korean Register of Shipping (KR)</b> - Certificate number: LOX17743-AE001
<b>SIL 2/3 Certification</b>	IEC 61508 SIL 2 for non-redundant use and SIL 3 for redundant use according to EXIDA and TÜV Nord Sys Tec GmbH & Co. KG under the following standards: IEC61508-1: 2010; IEC 61508-2: 2010; IEC61508-3: 2010.


### Other Certification Options

**Materials**

- NACE MRO175, MRO103, ISO15156

## Dimension (Inline Design)

**Reference Dimensions:** millimeters  
inches

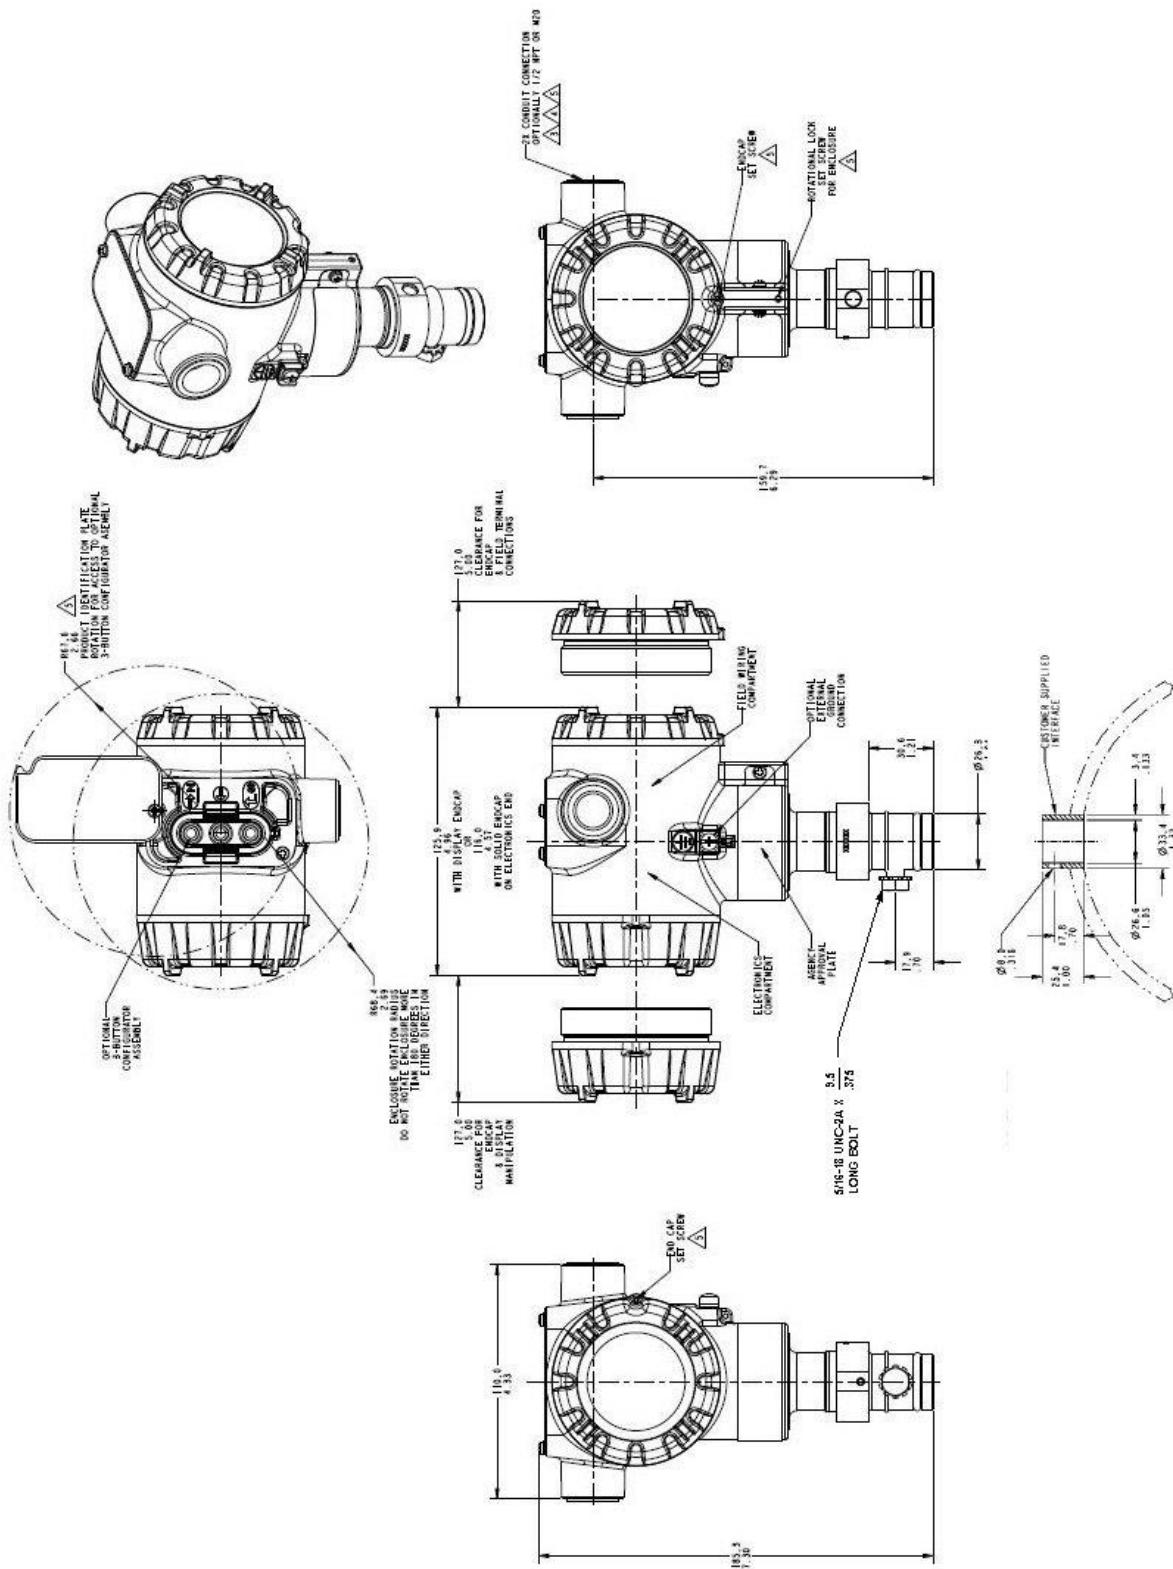

**Figure 3 Typical dimensions of STG73P**

## Model Selection Guide

Model Selection Guides are subject to change and are inserted into the specifications as guidance only.

### Model STG73P Flush Mount Pressure Transmitter

Model Selection Guide  
34-ST-16-113 Issue 17

**Instructions:** Make selections from all Tables using column below the proper arrow. Asterisk indicates availability. Letter (a) refers to restrictions highlighted in the restrictions table. Tables delimited with dashes.

Key	I	II	III	IV	V	VI	VII	VIII	IX
STG73P	-	-	-	-	-	-	-	-	0 0 0

KEY NUMBER	URL/Max Span	LRL	Min Span	Units
Flush Mount	100 (7.0)	-14.7 (-1.0)	1.0 (0.7)	psi (bar)

Selection	Availability
STG73P	↓

TABLE I METER BODY SELECTIONS		
a. Process Interface & Diaphragm	Process Interface Material	Barrier Diaphragm Material
	316L Stainless Steel	Hastelloy® C - 276 <sup>1</sup>
b. Fill Fluid	Silicone 200	
c. Process Connection	1" Slip in with locking screw (sleeve optional see table VIII)	
d. Bolt/Nuts Materials	None	
e. Vent/Drain	None	
f. Gasket/Seal	Viton O-ring	

F _____	*
_ 1 _____	*
_ _ 1 ____	*
_ _ _ 0 __	*
_ _ _ 0 _	*
_ _ _ B	*

<sup>1</sup> Hastelloy® C-276 or UNS N10276

TABLE II Meter Body & Connection Orientation	
Head/Connect Orientation	None

0	*
---	---

TABLE III AGENCY APPROVALS	
Approvals	No Approvals Required <FM> Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof CSA Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof ATEX Explosion proof, Intrinsically Safe & Non-incendive IECEx Explosion proof, Intrinsically Safe & Non-incendive SAEx Explosion proof, Intrinsically Safe & Non-incendive INMETRO Explosion proof, Intrinsically Safe & Non-incendive NEPSI Explosion proof, Intrinsically Safe & Non-incendive KOSHA Explosion proof, Intrinsically Safe & Non-incendive EAC Customs Union (Russia,Belarus,Kazakhstan) Ex Approval Flame proof, Intrinsically Safe & Non-incendive CCoE Explosion proof, Intrinsically Safe & Non-incendive UATR Flamproof, Intrinsically Safe & Dustproof

0	*
A	*
B	*
C	*
D	*
E	*
F	*
G	*
H	*
I	*
J	*
K	*

TABLE IV TRANSMITTER ELECTRONICS SELECTIONS			
a. Electronic Housing Material & Connection Type	Material	Connection	Lightning Protection
	Polyester Powder Coated Aluminum	1/2 NPT	None
	Polyester Powder Coated Aluminum	M20	None
	Polyester Powder Coated Aluminum	1/2 NPT	Yes
	Polyester Powder Coated Aluminum	M20	Yes
	316 Stainless Steel (Grade CF8M)	1/2 NPT	None
	316 Stainless Steel (Grade CF8M)	M20	None
b. Output/Protocol	Analog Output		Digital Protocol
	4-20mA dc		HART Protocol
	4-20mA dc none		DE Protocol Foundation Fieldbus
c. Customer Interface Selections	Indicator	Ext Zero, Span & Config Buttons	Languages
	None	None	None
	None	Yes (Zero/Span Only)	None
	Basic	None	EN
	Basic	Yes	EN
	Standard (w/internal Zero, Span & Conf Buttons)	None	EN

A _	*
B _	*
C _	*
D _	*
E _	*
F _	*
G _	*
H _	*
H _	*
D _	*
F _	*
O _	*
A _	f
B _	*
C _	*
D _	u

<b>TABLE V</b>		<b>CONFIGURATION SELECTIONS</b>					
<b>a. Application Software</b>	<b>Diagnostics</b>						
	Standard Diagnostics						
<b>b. Output Limit, Failsafe &amp; Write Protect Settings</b>	<b>Write Protect</b>	<b>Fail Mode</b>	<b>High &amp; Low Output Limits<sup>3</sup></b>				
	Disabled	High> 21.0mAdc	Honeywell Std	(3.8 - 20.8 mAdc)			
	Disabled	Low< 3.6mAdc	Honeywell Std	(3.8 - 20.8 mAdc)			
	Enabled	High> 21.0mAdc	Honeywell Std	(3.8 - 20.8 mAdc)			
	Enabled	Low< 3.6mAdc	Honeywell Std	(3.8 - 20.8 mAdc)			
	Enabled	N/A	N/A	Fieldbus			
<b>c. General Configuration</b>	<b>General Configuration</b>						
	Factory Standard Custom Configuration (Unit Data Required from customer)						

<sup>3</sup> NAMUR Output Limits are configurable by customer

1 _ _	*
_ 1 _	f
_ 2 _	f
_ 3 _	f
_ 4 _	f
_ 5 _	g
_ 6 _	g

-- S	*
-- C	*

<b>TABLE VI</b>			<b>CALIBRATION &amp; ACCURACY SELECTIONS</b>	
<b>a. Accuracy and Calibration</b>	<b>Accuracy</b>	<b>Calibrated Range</b>	<b>Calibration Qty</b>	
	Standard	Factory Standard	Single Calibration	*
	Standard	Custom (Unit Data Required)	Single Calibration	*

A	*
B	*

<b>TABLE VII</b>			<b>ACCESSORY SELECTIONS</b>			
<b>a. Mounting Bracket</b>	None(Not required with Flush Mount Unit)					
	<b>Customer Tag Type</b>					
<b>b. Customer Tag</b>	No customer tag					
	One Wired Stainless Steel Tag (Up to 4 lines 26 char/line) Two Wired Stainless Steel Tag (Up to 4 lines 26 char/line)					
<b>c. Unassembled Conduit Plugs &amp; Adapters</b>	<b>Unassembled Conduit Plugs &amp; Adapters</b>					
	No Conduit Plugs or Adapters Required 1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter 1/2 NPT 316 SS Certified Conduit Plug M20 316 SS Certified Conduit Plug Minifast® 4 pin (1/2 NPT) (not suitable for X-Proof applications) Minifast® 4 pin (M20) (not suitable for X-Proof applications)					

0 _ _	*
_ 0 _	*
_ 1 _	*
_ 2 _	*
-- A0	*
-- A2	n
-- A6	n
-- A7	m
-- A8	n
-- A9	m

<b>TABLE VIII</b>			<b>OTHER Certifications &amp; Options: (String in sequence comma delimited (XX, XX, XX,...))</b>							
<b>Certifications &amp; Warranty</b>	No additional options									
	NACE MR0175; MR0103; ISO15156 (FC33338) Process wetted parts only									
	NACE MR0175; MR0103; ISO15156 (FC33339) Process wetted and non-wetted parts									
	Marine (DNV, ABS, BV, KR, LR) (FC33340)									
	EN10204 Type 3.1 Material Traceability (FC33341)									
	Certificate of Conformance (F3391)									
	Calibration Test Report & Certificate of Conformance (F3399)									
	Certificate of Origin (F0195)									
	FMEDA (SIL 2/3) Certification (FC33337)									
	Calibration Fixture (w/1/4" NPT port)									
PMI Certification <sup>1</sup>										
316L Stainless 1" Mounting Sleeve (requires customer installation to process piping)										
Extended Warranty Additional 1 year										
Extended Warranty Additional 2 years										
Extended Warranty Additional 3 years										
Extended Warranty Additional 4 years										

00	*
FG	*
F7	*
MT	d
FX	*
F3	*
F1	*
F5	*
FE	j
CF	*
PM	*
MS	*
01	*
02	*
03	*
04	*

0000	*
------	---

<b>TABLE IX</b>		<b>Manufacturing Specials</b>	
<b>Factory</b>	Factory Identification		
	0	0	0

0000	*
------	---

## RESTRICTIONS

Restriction Letter	Available Only with		Not Available with	
	Table	Selection(s)	Table	Selection(s)
d	Iva	C,D,G,H __		
f			IV b	_ F_
g			IVb	_ H,D_
j	IV b	_ H __	Vb	_ 1,2,6_
m	IV a	B,D,F,H __		
n	IV a	A,C,E,G __		
u	IV b	_ H __		
b	Select Only one option from this group			

<sup>1</sup>The PM option is available on all Smartline Pressure Transmitter process wetted parts such as process heads, flanges, bushings and vent plugs except plated carbon steel process heads and flanges. PM option information is also available on diaphragms except STG and STA in-line construction pressure transmitters.

## FIELD INSTALLABLE ACCESSORY KITS

Description	Kit Number
Integrally Mounted Basic Indicator Kit (Compatible with all Electronic Modules)	50049911-501
Terminal Strip w/Lightning Protection Kit for HART or DE Modules	50075472-532
Terminal Strip w/Lightning Protection Kit for FFB Module	50075472-534
Terminal Strip w/o Lightning Protection for HART or DE Modules	50075472-531
Terminal Strip w/o Lightening Protection FFB-Module	50075472-533
HART Electronics Module	50049849-501
HART Electronics Module w/connection for external configuration buttons	50049849-502
DE Electronics Module	50049849-503
DE Electronics Module w/connection for external configuration buttons	50049849-504
FFB Electronics Module Kit	50049849-509
FFB Electronics Module w/connection for external configuration buttons	50049849-510
Standard Display Module	50126003-501

## PRODUCT MANUALS

Description	Part Number
ST 700 SmartLine Transmitter User Manual - English	34-ST-25-44
ST 700 SmartLine Transmitter HART/DE Communications Manual - English	34-ST-25-47
ST 700 SmartLine Transmitter Safety Manual - English	34-ST-25-37
ST700 SmartLine Transmitter Foundation Fieldbus Manual - English	34-ST-25-48
ST 700 SmartLine Transmitter Function Block Manual - English	34-ST-25-49

All product documentation is available at [www.honeywellprocess.com](http://www.honeywellprocess.com).

## Sales and Service

For application assistance, current specifications, ordering, pricing, and name of the nearest Authorized Distributor, contact one of the offices below.

### ASIA PACIFIC

Honeywell Process Solutions,  
Phone: + 800 12026455 or  
+44 (0) 1202645583  
(TAC) [hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

#### Australia

Honeywell Limited  
Phone: +(61) 7-3846 1255  
FAX: +(61) 7-3840 6481  
Toll Free 1300-36-39-36  
Toll Free Fax:  
1300-36-04-70

**China – PRC - Shanghai**  
Honeywell China Inc.  
Phone: (86-21) 5257-4568  
Fax: (86-21) 6237-2826

#### Singapore

Honeywell Pte Ltd.  
Phone: +(65) 6580 3278  
Fax: +(65) 6445-3033

#### South Korea

Honeywell Korea Co Ltd  
Phone: +(822) 799 6114  
Fax: +(822) 792 9015

### EMEA

Honeywell Process Solutions,  
Phone: + 800 12026455 or  
+44 (0) 1202645583

#### Email: (Sales)

[FP-Sales-Apps@Honeywell.com](mailto:FP-Sales-Apps@Honeywell.com)  
or  
(TAC)  
[hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

#### Web

Knowledge Base search  
engine <http://bit.ly/2N5Vldi>

### AMERICAS

Honeywell Process Solutions,  
Phone: (TAC) (800) 423-9883  
or (215) 641-3610  
(Sales) 1-800-343-0228

#### Email: (Sales)

[FP-Sales-Apps@Honeywell.com](mailto:FP-Sales-Apps@Honeywell.com)  
or  
(TAC)  
[hfs-tac-support@honeywell.com](mailto:hfs-tac-support@honeywell.com)

#### Web

Knowledge Base search  
engine <http://bit.ly/2N5Vldi>

*Specifications are subject to change without notice.*

#### For more information

To learn more about SmartLine Transmitters,  
visit [www.honeywellprocess.com](http://www.honeywellprocess.com)  
Or contact your Honeywell Account Manager

#### Process Solutions

Honeywell  
1250 W Sam Houston Pkwy S  
Houston, TX 77042

Honeywell Control Systems Ltd  
Honeywell House, Skimmed Hill Lane  
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road  
Shanghai, China 20061

**Honeywell**

34-ST-03-108

January 2022

©2022 Honeywell International Inc.

[www.honeywellprocess.com](http://www.honeywellprocess.com)